



Batch Finished Alarm



Batch Finished Alarm:
Option 1

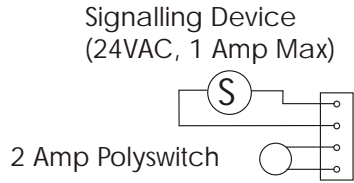

Batch Finished Alarm:
Option 2
(dry contact)

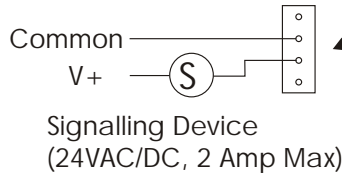

Batch Finished Alarm:
Option 3

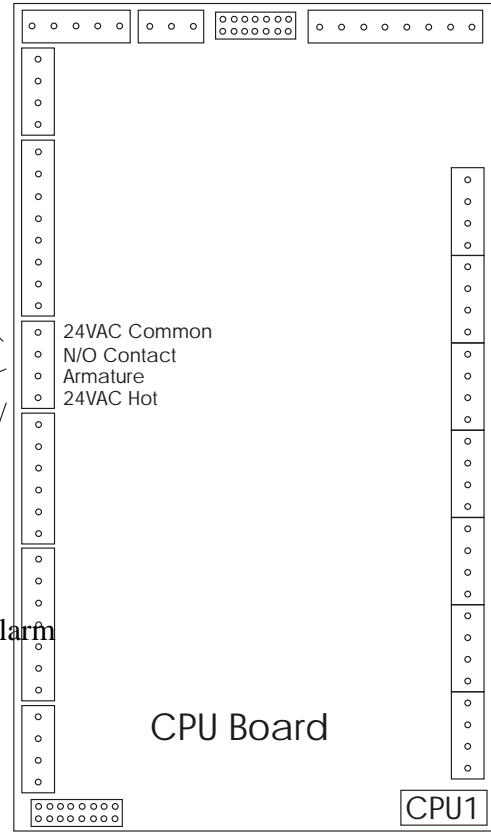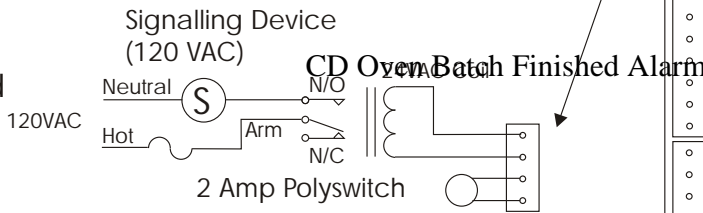


Batch Finished Relay - Factory Software Options



- Option 1. Relay closes for preset time 1-62 seconds - factory default 5 seconds
- Option 2. Relay is latched until Cancel Timer or Start Timer buttons are pressed

General Alarm Interfacing:

Option 1 (Low Current)

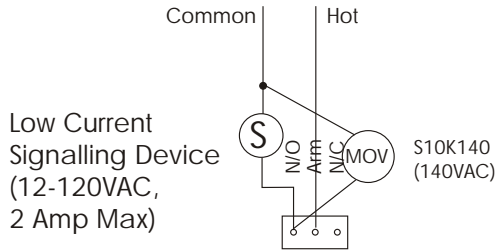

Option 2 (High Current)

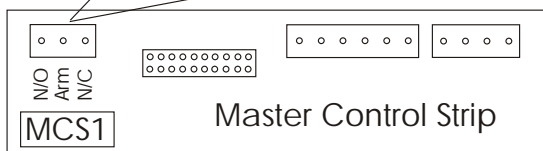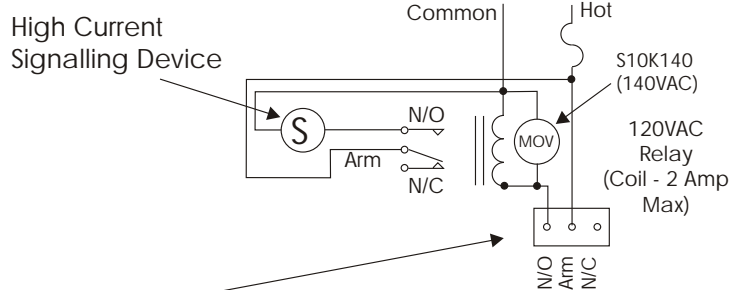

Trinity Electronics Systems Ltd
Edmonton, Alberta, Canada

Batch Finished Alarm & General Alarm Interfacing

Drawn	Date	Drawing	Rev	Sht.
LP	15/Apr/02	Alrm_IF.CDR	A0	1/1